

DISS



Features:

Flow rate exceeds the requirements of NFPA and CSA

Accepts DISS gas specific adapters

100 % Hydrostatic testing of each outlet and cleaned for medical gas service

Indexed to eliminate interchangeability of gas services

Up to 3/4" [19 mm] mounting plate thickness adjustment.

Universal rough-in assembly to accept Quick Disconnects or DISS Front Adapters (Can be interchanged at any time)

Outlets are also available for M.R.I. use

DISS back body connection

General Specifications:

The medical gas outlet shall be an Amico Alert-1 series.

Outlet back bodies shall be manufactured with a DISS gas specific fitting which accepts only DISS specific adapters. Body shall be 1-5/16" [33 mm] diameter one piece brass construction.

Outlet bodies shall be gas specific by indexing each gas service to a gas specific dual pin indexing arrangement on the respective identification module.


All M.R.I. outlets are manufactured from nonferrous material.

All outlets shall be cleaned and degreased for medical gas service, factory assembled and tested.

Outlets are UL Listed and ETL Listed.

Amico products comply with NFPA-99.

Technical Specifications

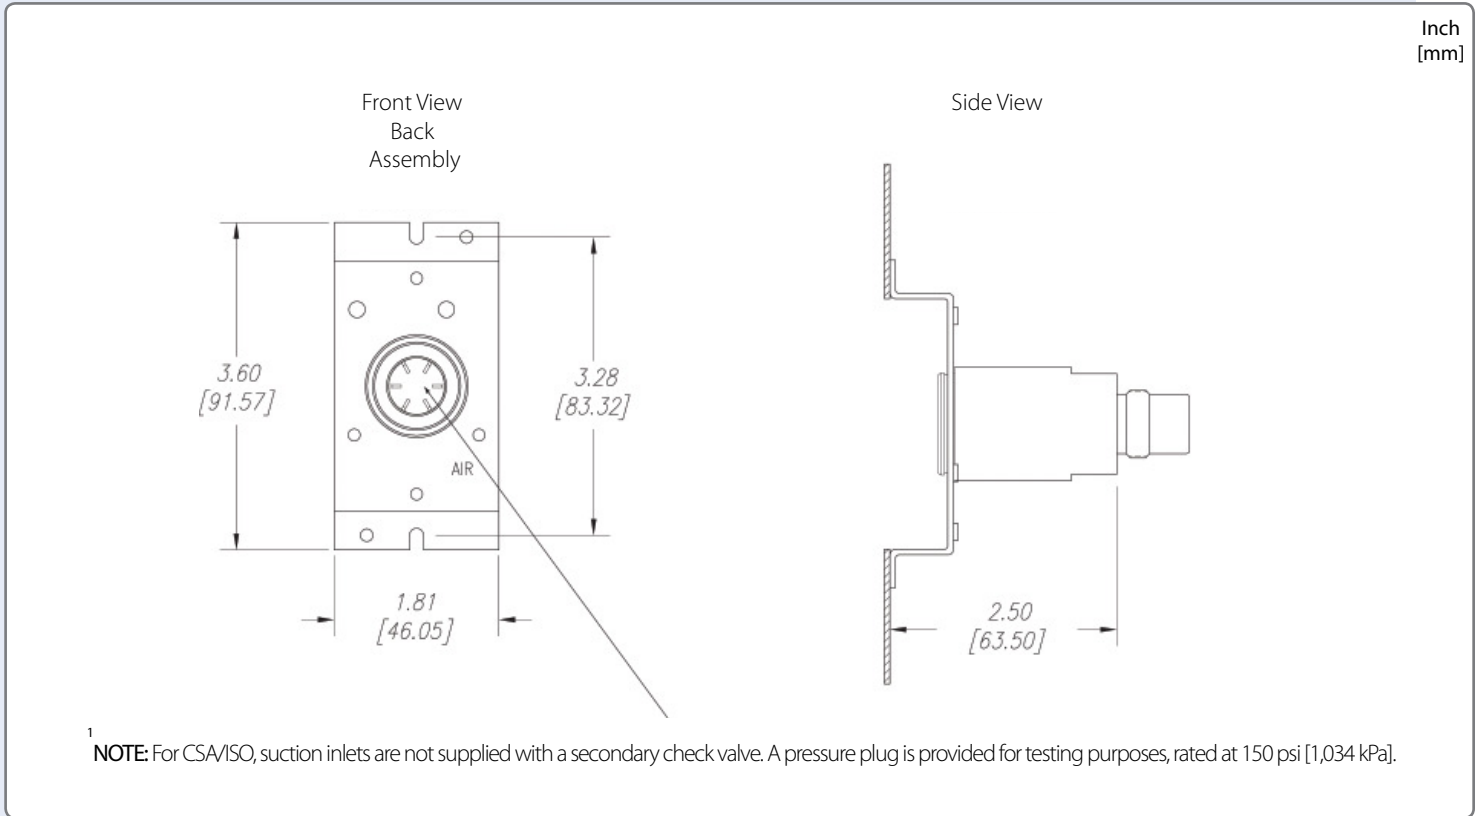

Model Numbers

O-BAKCCOD-L-XXX

The "L" defines the Language:

- U = English (NFPA) Oxy, Air, Vac and WAG only
- E = English (CSA/ISO)

The "XXX" defines the Gas:

- | | | |
|---|---|-------|
| Oxygen | = | OXY |
| Medical Air | = | AIR |
| Nitrous Oxide | = | N2O |
| Nitrogen | = | NIT |
| Carbon Dioxide | = | CO2 |
| MedVac ¹ | = | VAC |
| Waste Anesthetic
Gas Disposal
(NFPA) | = | WAG |
| Anesthetic Gas
Scavenging
System ¹ (CSA) | = | AGS |
| Instrument Air | = | INAIR |
| Heliox | = | HOX |

¹Please see note above

Example: NFPA - DISS, Oxygen = O-BAKCCOD-U-OXY