

# Satin Finish Console Outlet

## DISS



### Features:

- Flow rate exceeds the requirements of NFPA
- Accepts only DISS gas specific adapters
- 100 % Hydrostatic testing of each outlet and cleaned for medical gas service
- Indexed to eliminate interchangeability of gas services
- Up to 3/4" [19 mm] mounting plate thickness adjustment
- 360° swivel inlet pipe for easy installation
- Universal rough-in assembly to accept Quick Disconnects or DISS front adapters (Can be interchanged at any time)
- Outlets are also available for M.R.I. use

### General Specifications:

The medical gas outlet shall be an Amico Alert-1 series.

Outlets shall be manufactured with a 6 - 1/2" [165 mm] length type "K" 1/2" [12.7 mm] outside diameter (3/8" nominal) size copper inlet pipe stub which is silver brazed to the outlet body. The body shall be of 1 - 5/16" [33 mm] diameter, one piece brass construction. For positive pressure gas services, the outlet shall be equipped with a primary and secondary check valve and the secondary check valve shall be rated at a maximum of 200 psi [1,379 kPa] in the event the primary check valve is removed for maintenance. Outlet bodies shall be gas specific by indexing each gas service to a gas specific single pin indexing arrangement on the respective identification module.

A satin finish color coded front plate shall be used for gas identification and aesthetic appeal.

With the back rough-in mounted, the outlet shall adjust up to 3/4" [19 mm] variation in mounting plate thickness.

The latch-valve assembly shall be DISS type and only accept corresponding DISS type gas specific adapters.


All M.R.I. outlets are manufactured from nonferrous materials.

All outlets shall be cleaned and degreased for medical gas service, factory assembled and tested.

The outlets are UL Listed and ETL Listed.

Amico products comply with NFPA-99.

# Technical Specifications

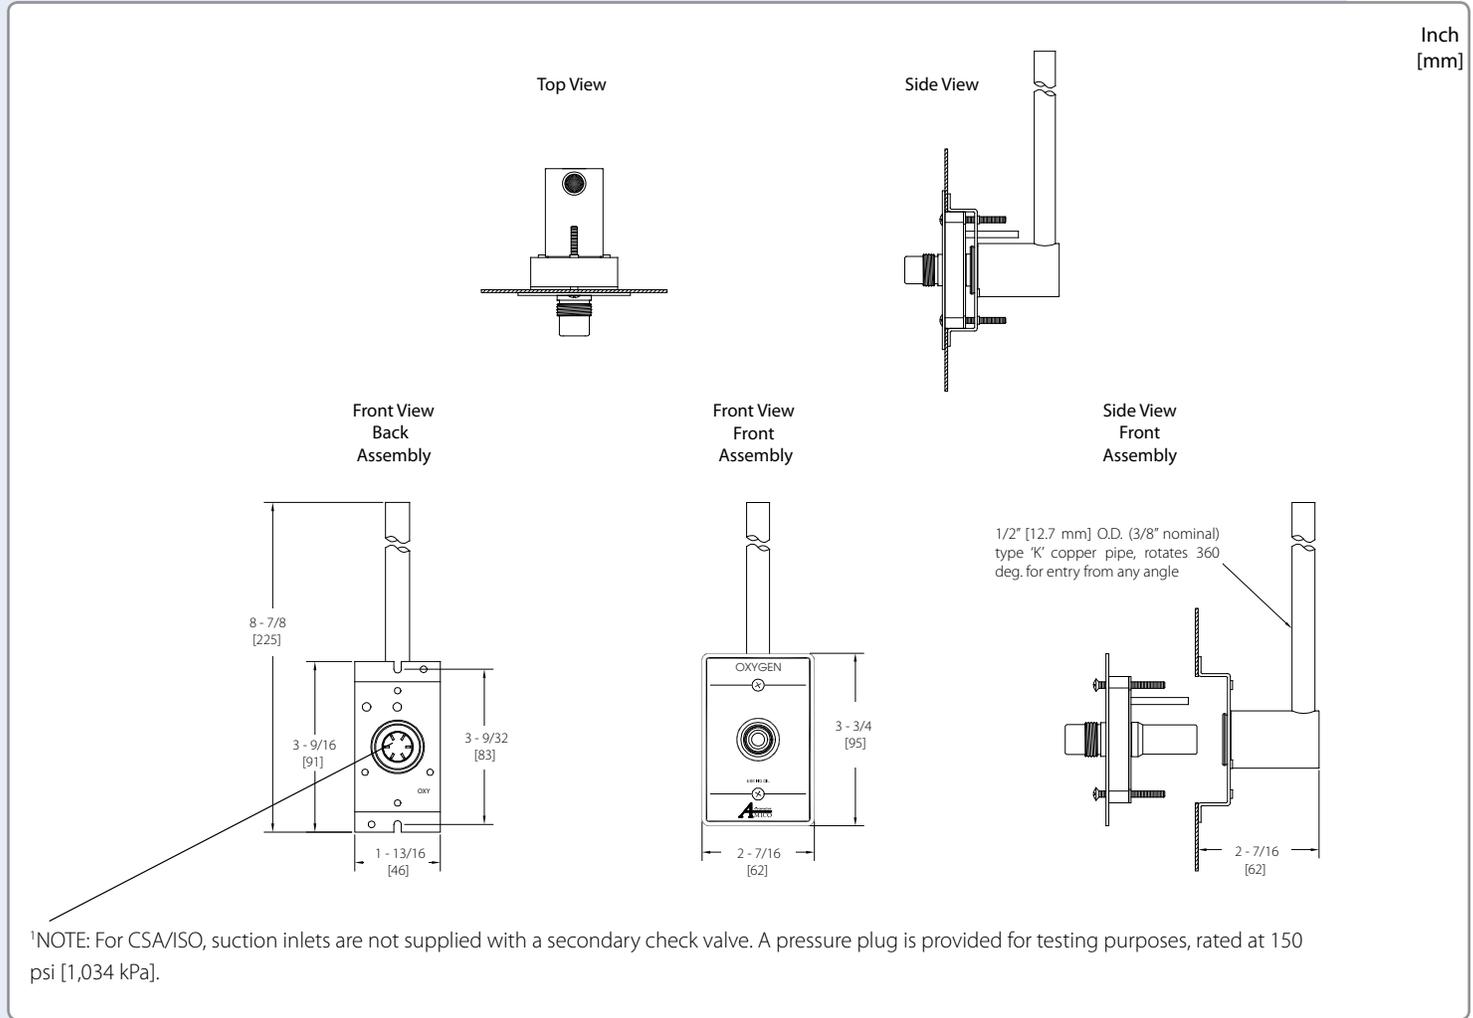

## Model Numbers

Complete DISS Satin Finish Console Outlet Assembly

### O-DISCON-L-XXX-S

**NOTE:** The complete DISS Satin Finish Console Outlet Assembly will consist of:

QTY.1

### O-FPOC-DI-L-XXX

(Front Latch Assembly)

QTY.1

### O-BAKCON-L-XXX-S

(Rough-in Assembly)

QTY.1

### O-TRIM-P275G

(Trim Plate)

#### The "L" Defines the Language:

U = English (NFPA) OXY, AIR, VAC  
and WAG

E = N<sub>2</sub>O, CO<sub>2</sub> & NIT

#### The "XXX" Defines the Gas:

Oxygen	=	OXY
Medical Air	=	AIR
Carbon Dioxide	=	CO <sub>2</sub>
Nitrogen	=	NIT
Nitrous Oxide	=	N <sub>2</sub> O
MedVac <sup>1</sup>	=	VAC
Waste Anesthetic Gas Disposal (NFPA)	=	WAG

<sup>1</sup>Please see note above

## Complete DISS Satin Finish Console Outlet Assembly

### **O-DISCONM-L-XXX-S**

**NOTE:** The complete DISS Satin Finish Console Outlet Assembly will consist of:

QTY.1

### **O-FPOM-DI-L-XXX**

(Front Latch Assembly)

QTY.1

### **O-BAKCONM-L-XXX-S**

(Rough-in Assembly)

QTY.1

### **O-TRIM-P275G**

(Trim Plate)

#### The "L" Defines the Language:

U = English (NFPA) OXY, AIR, VAC and WAG

E = N2O, CO2 & NIT

#### The "XXX" Defines the Gas:

Oxygen	=	OXY
Medical Air	=	AIR
Carbon Dioxide	=	CO2
Nitrogen	=	NIT
Nitrous Oxide	=	N2O
MedVac <sup>1</sup>	=	VAC
Waste Anesthetic Gas Disposal (NFPA)	=	WAG

<sup>1</sup>Please see note above

Distributed by: